


MVN7505/7510/6105/6105-A/6110/6110-A/4605/4610

电动球阀执行器


Ball Valve Actuator

安装说明 • INSTALLATION INSTRUCTIONS

安装之前请断开电源。 Disconnect power before installation

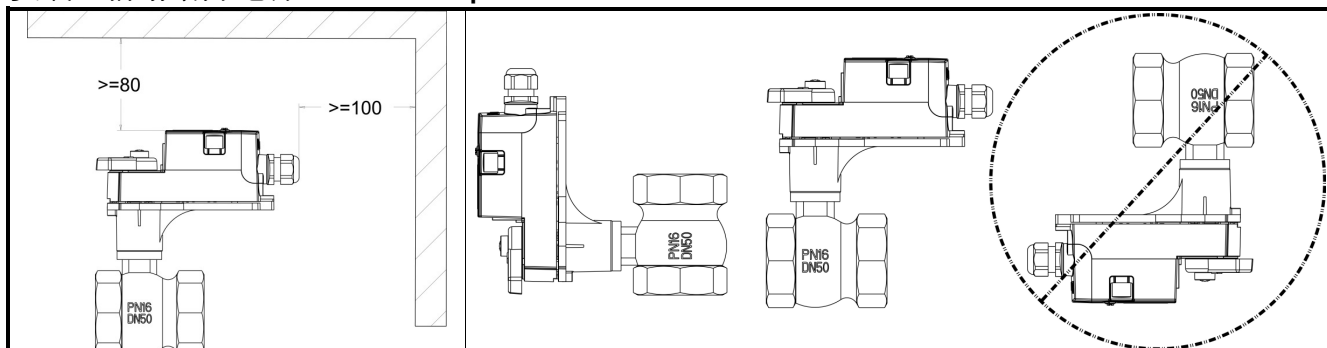


A1-A 5: 执行器与阀门的安装. Mounting Actuator to Ball Valve

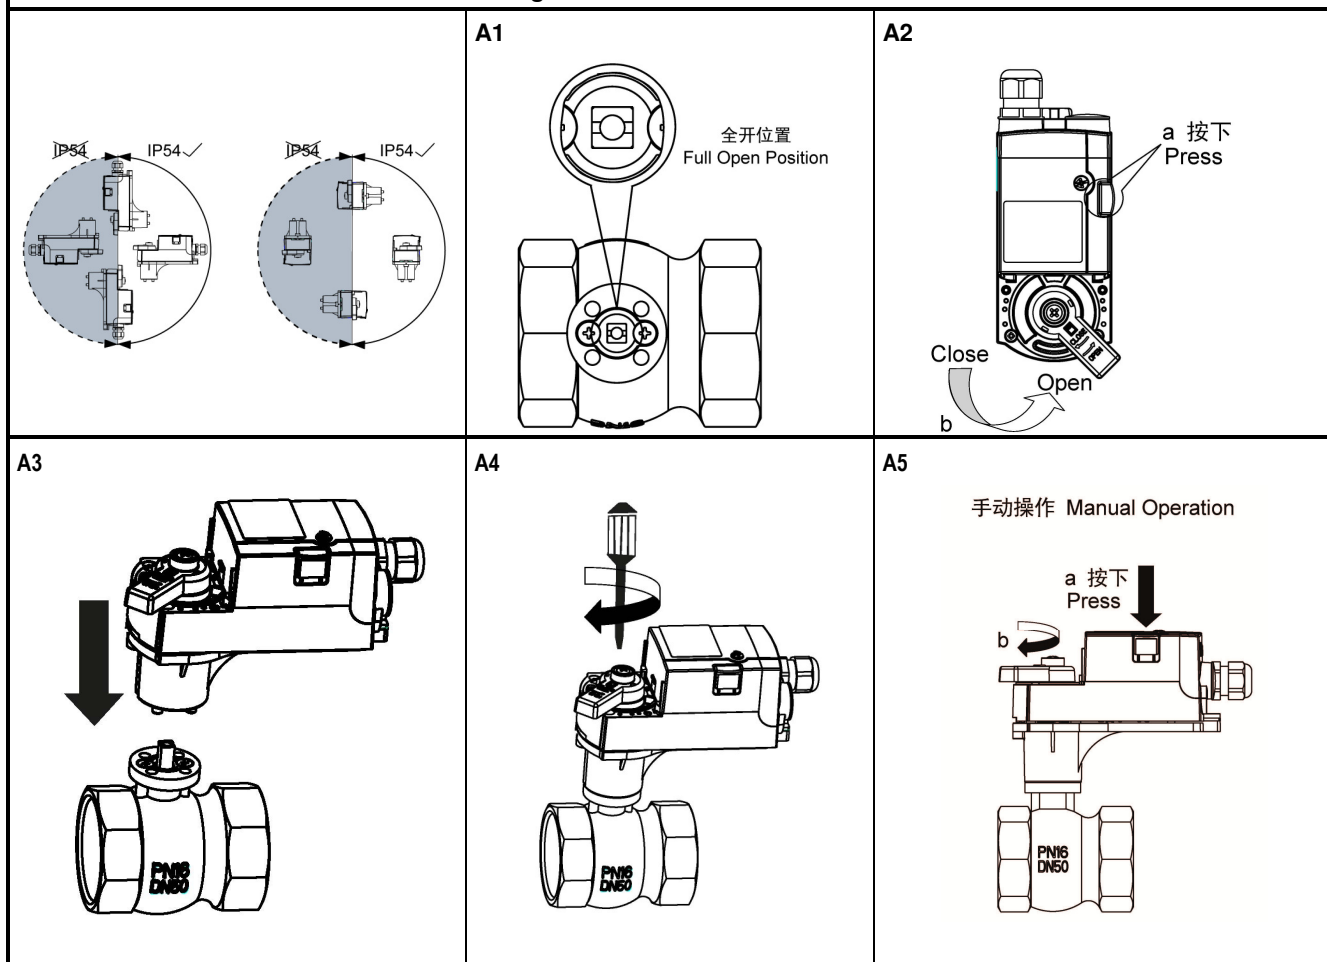


B1-B6: 执行器接线. Wiring


B1

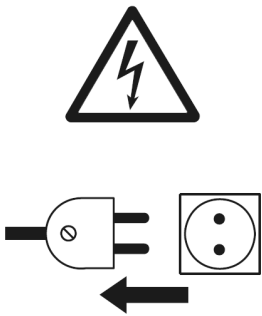


B2: 调节旋钮(默认)
Adjust Knob (Default Position)

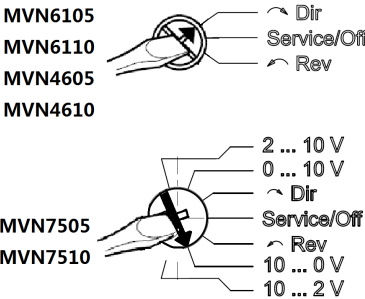


B3

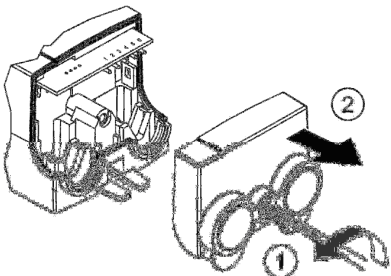


B4

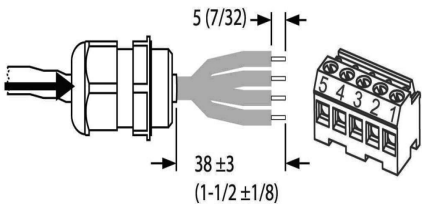

B5

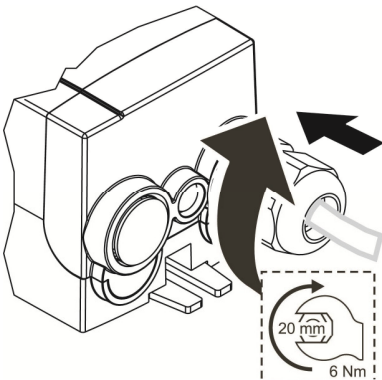


B6

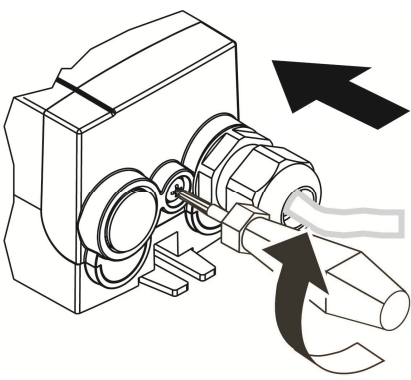


C1-C: 接线图. Wiring Diagram

C1: MVN6105, MVN6110

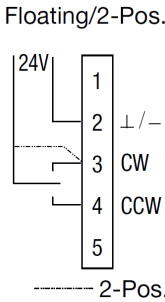


C2: MVN7505, MVN7510

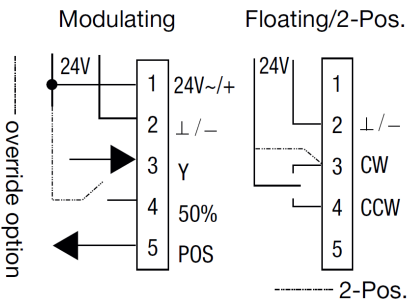


C3: MVN4605, MVN4610

2-Position (↻ Dir)



C4: MVN6105-A, MVN6110-A

End Switches (max. 30VDC, 3A) Floating/2-Pos.

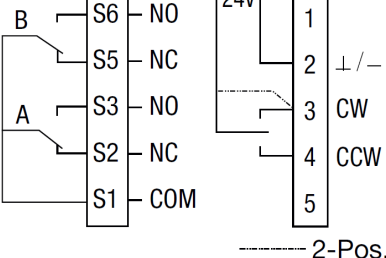

China RoHS card: PWBA_Pb

部件名称 Component Name	有害物质 Hazardous Substances					
	铅(Pb)	汞(Hg)	镉(Cd)	六价铬(Cr6+)	多溴联苯(PBB)	多溴二苯醚(PBDE)
电路板组件 PWBA	X	○	○	○	○	○
本表格依据 SJ/T 11364 的规定编制。 This table is prepared in accordance with the provisions of SJ/T 11364.						
○: 表示该有害物质在该部件所有均质材料中的含量均在 GB/T 26572 规定的限量要求以下。 Indicates that said hazardous substance contained in all of the homogeneous materials for this part is below the limit requirement of GB/T 26572.						
X: 表示该有害物质至少在该部件的某一均质材料中的含量超出 GB/T 26572 规定的限量要求。 Indicates that said hazardous substance contained in all of the homogeneous materials for this part is above the limit requirement of GB/T 26572.						

未列入表内的其他部件，皆不含任何超出限量要求的限制使用物质。

All other components, not listed in the table, do not contain restricted substances above the threshold level.